


Lianyungang Goodlink Fluid Equipment Co.,Ltd.

Design Data for Bottom Loading Arms

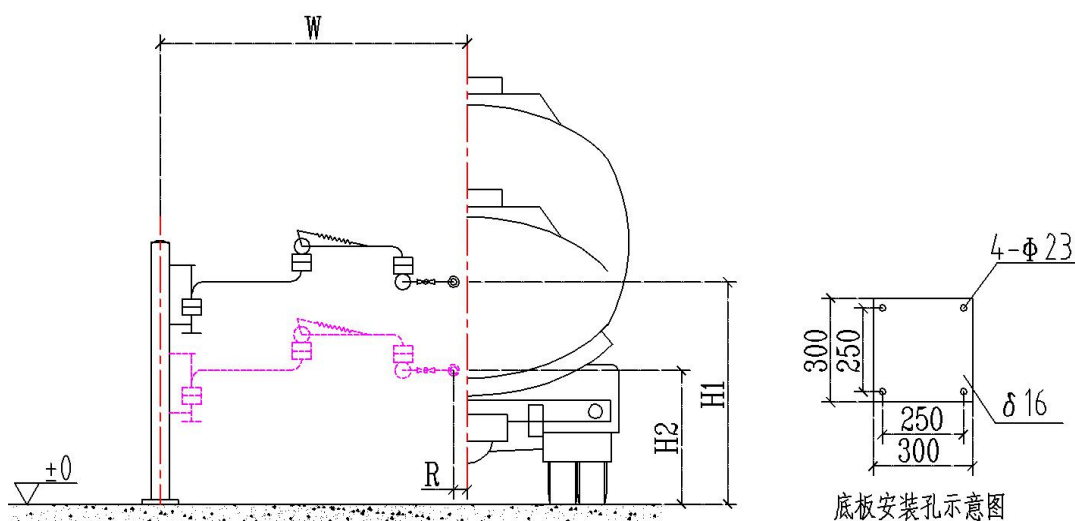

Parameter by client			
1	distance between stand column and tanker center	W	mm
2	distance between tanker connector and tanker center	R	mm
3	Max height of tanker connector	H1	mm
4	Min height of tanker connector	H2	mm
5	Loading arm model and size		
6	Inlet flange standard and design pressure		
7	Fluid/ pipeline material		
8	Direction		
9	Color		
Optional Configuration			
1	Valve		
2	Quick coupling		
3	Emergency release valve		
Others:			

Signature (stamp) : _____

Date: _____